


Street on Cement Treated Base



NOTES:

1. BASE, SUB-BASE, AND SUBGRADE THICKNESS VARY WITH LOADS, SUBGRADE STRENGTH, AND CLIMATE.
2. CONCRETE PAVERS MAY BE INLAYED ON EXISTING ASPHALT OR CONCRETE GAS STATION PAVEMENTS.
3. SEALING JOINTS OF PAVERS IS RECOMMENDED FOR GAS STATION APPLICATIONS.
4. PROVIDE 2 IN. (50 MM) DIAMETER DRAIN HOLE(S) FILLED W/ PEA GRAVEL AT LOWEST ELEVATIONS. DRAIN TO EMERGENCY SPILL CATCHMENT.
5. PROVIDE 1 IN. (25 MM) DIAMETER HOLES THROUGH CURBS TO CATCH BASINS. BOTTOM OF HOLES TO BE EVEN WITH SURFACE OF CEMENT-TREATED BASE. COVER HOLES WITH GEOTEXTILE.

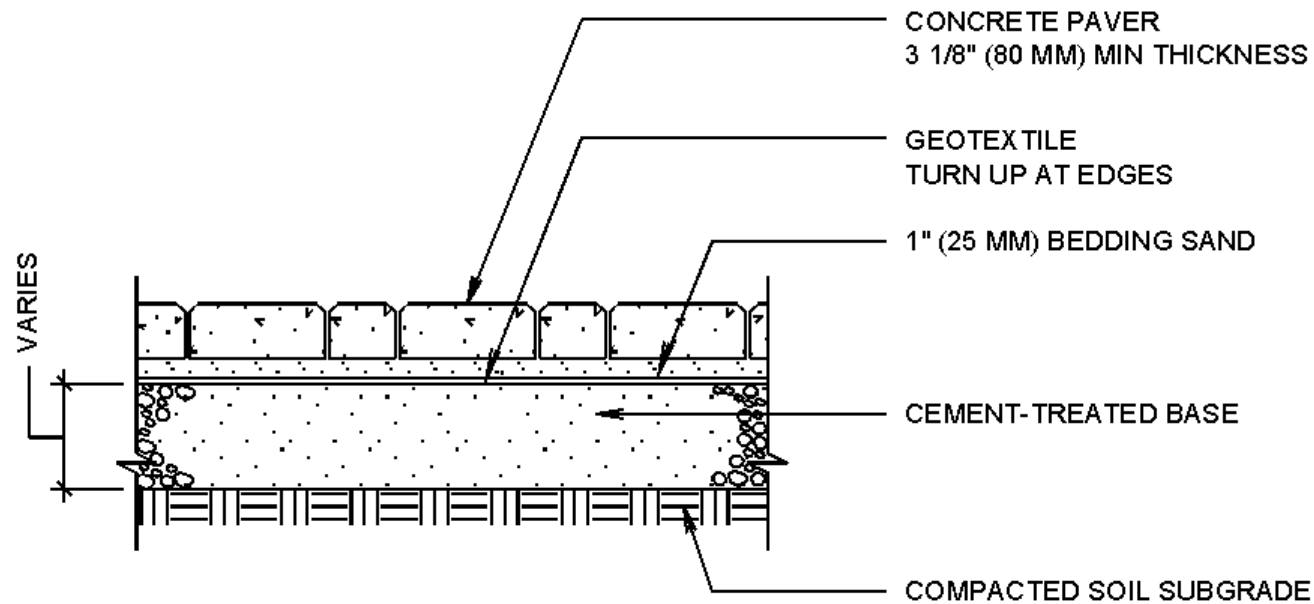

Creating elegant hardscaping environments.

118 International Drive, Suite 101
Morrisville, NC 27560

800-292-7220

www.fredadampaving.com